

## ACCENT HOUSING - FIRE RISK ASSESSMENT



**Region :** Yorkshire

**Scheme Name :** 7 Oak Mount

**Scheme Address :** Oak Mount  
Bradford  
BD8 7BE

**Date of Assessment:** 08/02/2024

**Date of Next Assessment:** 08/02/2027

**FRA Frequency:** 3 Year Re-Assessment

**Fire & Safety Assessor** Steve Manners

This Fire Risk Assessment has been conducted upon the instruction of Accent Housing.

Scheme Details		7 Oak Mount
<b>Region:</b>	Yorkshire	
<b>Scheme Name:</b>	7 Oak Mount	
<b>Site Address:</b>	<b>Street:</b>	Oak Mount
	<b>Town:</b>	Bradford
	<b>Post Code:</b>	BD8 7BE
<b>Block &amp; Asset No.</b>	8977	
<b>Scheme Tel. No:</b>		
<b>Date of this Assessment</b>	08/02/2024	
<b>Date of Next Review</b>	08/02/2027	
<b>Fire Risk Assessment Frequency</b>	3 Years	
<b>Health &amp; Safety Assessment Frequency</b>	3 Years	
<b>Purpose of Fire Risk Assessment</b>	3 Year Re-Assessment	
<b>Fire &amp; Safety Assessor</b>	Steve Manners	
<b>Director of Customer Experience</b>	Alex Liburd	
<b>Customer Partnership Manager</b>	Jenny Baines	
<b>Contract Manager</b>	Mike Williams	
<b>Scheme Manager/Customer Partner</b>	Charlotte Jackson	
<b>Other staff in attendance</b>	None	
<b>Use of Building</b>	General Needs	
<b>Approximate Number of occupants</b>	8	
<b>Occupancy Profile</b>	Families	
<b>Familiarity of the occupants</b>	Fully Familiar	
<b>Likely state of the Occupants</b>	Alert	
<b>PEEPs in place where necessary</b>	N/A	
<b>Number of on-site Accent staff</b>	None	
<b>Number of other (non-Accent) staff</b>	Contract cleaners in common areas	
<b>Support Agency (Supported Housing)</b>	N/A	
<b>Current Evacuation Strategy.</b>	Full (Simultaneous) Evacuation	
<b>Evidence that residents have been notified of the evacuation procedure</b>	Advice notices displayed in common areas	
<b>History of fires in the building</b>	None	
<b>Business Continuity Plan in place?</b>	Yes	
<b>Scope of Assessment</b>	Type 1 (Common Parts Only - Non Destructive)	
<b>Applicable Fire Safety Guidance</b>	Sleeping Accommodation Guide	
	LACORS Guide	

<b>Building Details</b>	<b>7 Oak Mount</b>
<b>Construction Date</b>	Circa 1880
<b>Construction Type</b>	Joisted or Load Bearing Masonry (Traditional)
<b>Roof Finish</b>	Pitched-Slate Tile
<b>External Wall Finish</b>	Stone
<b>Are there any areas of external wall cladding</b>	No
<b>Are there any balconies</b>	No
<b>Conversion or purpose-built</b>	
<b>Number of flats (self-contained)/rooms (HMOS, shared houses)</b>	4
<b>Number of storeys above ground</b>	Two
<b>Number of storeys below ground</b>	One
<b>Is there a habitable basement?</b>	No
<b>Number of internal Staircases per Block (protected or unprotected?)</b>	One-Protected
<b>Number of External Staircases per Block</b>	One
<b>External Balcony part of escape route?</b>	No
<b>Unusual features</b>	none
<b>Building complexity</b>	Simple
<b>Building Access Conditions for Fire Brigade</b>	Vehicular Access to one or more elevations
<b>Surroundings: Residential/Commercial</b>	Residential
<b>Fire Provision Currently in Place</b>	
<b>Fire Detection and Warning System</b>	Flats and common areas not linked
<b>Grade of fire alarm</b>	Grade D
<b>Category of fire alarm</b>	LD3 Minimum Protection
<b>Additional Comments:</b>	
<b>Evacuation Alert System (EAS)</b>	Not Fitted
<b>Additional Comments:</b>	
<b>Emergency Lighting Provision</b>	Non Maintained System - Common Areas
<b>Additional Comments:</b>	
<b>Portable Fire Extinguishers</b>	None fitted
<b>Additional Comments:</b>	
<b>Fixed Fire Fighting Installations</b>	None fitted
<b>Additional Comments:</b>	

Significant Findings - Fire						
7 Oak Mount					08/02/2024	
Action Ref:	Potential Area of Fire Risk	Yes-No-N/A	Observation/Comments/ Actions Required	Risk Rating	Target Completion Date	Referred To:
<b>Fire Hazards</b>						
<b>1</b>	<b>Electrical Sources of Ignition:</b>					
1.1	Electrical Installation within common areas (Fixed Wiring, sockets, switches, light fittings) in good condition and no obvious damage	Yes	All common area sockets and fittings in a satisfactory condition at the time of inspection	.		
1.2	Valid Electrical Installation Condition Reports held on file.(Common Areas)	Yes	Valid communal area EIC Reports for all blocks uploaded to property file In date at time of	.		
1.3	Valid Electrical Installation Condition Reports held on file. (General Needs Flats)	Yes	Valid General Needs flats EIC Reports uploaded to property file. In date at time of inspection	.		
1.4	Electrical App/PA Testing - all portable appliances tested within past 12 months	N/A		.		
1.5	Absence of trailing leads and adapters	N/A		.		
1.6	Mobility Scooters - Stored/charged in common areas, purpose built store/resident flat	N/A	No evidence or reports that any of the residents own a mobility scooter	.		
<b>2</b>	<b>Smoking:</b>					
2.1	Are there any risks associated with smoking in the building?	Yes	Smoking only permitted within flats	.		
<b>3</b>	<b>Arson:</b>					
3.1	Adequate security against arson?	Yes	Building secure - Intercom door entry system with trade button access.	.		
3.2	Is there an absence of unnecessary fire load in close proximity to building?	Yes	All external common areas clear at time of inspection	.		

<b>4</b>	<b>Heating Installations (Portable/fixed) Gas Installations - Common Areas &amp; General Needs Residential flats.</b>				
4.1	If portable heaters are used, are there suitable controls?	N/A		.	
4.2	Are fixed heating installations subject to regular maintenance?	N/A		.	
4.3	Valid LGSC held on file for each residential flat that contains gas appliances.	Yes	Any Flat that has a gas supply, Gas Safety Certs uploaded to property file.	.	
<b>5</b>	<b>Cooking:</b>				
5.1	Are reasonable measures taken to prevent fires as a result of cooking?	Yes	Cooking only permitted within flats	.	
5.2	Where there is extraction ventilation in communal kitchens are filters changed/cleaned and ductwork cleaned regularly?	N/A		.	
<b>6</b>	<b>Lightning Protection System:</b>				
6.1	Does the building have a lightning protection system, If so, is it adequately maintained?	N/A	No lightning conductor system fitted	.	
<b>7</b>	<b>Housekeeping:</b>				
7.1	Is the standard of housekeeping adequate?	Yes	All cupboards secure and clear at time of inspection	.	
7.2	Are all electrical/intake/service cupboards secure and free from general waste, contractors waste and residents personal items.	Yes	All areas clear at time of inspection	.	
7.3	Are combustible materials separated from ignition sources and stored appropriately?	Yes	All areas clear at time of inspection	.	
7.4	Are unnecessary accumulations of combustible materials or waste avoided?	Yes	All areas clear at time of inspection	.	
7.5	Are hazardous materials stored appropriately (i.e. oxygen cylinders, flammable materials, explosive products, oxidising products, aerosols)	N/A	No evidence of hazardous materials stored on site	.	
<b>8</b>	<b>Furniture/furnishings on escape routes and other communal areas:</b>				

8.1	Furniture/furnishings in good condition, fire retardant and complies with 1988 Regulations.	N/A	Furniture not permitted in communal areas at general needs schemes	.		
<b>9 Other Significant Fire Hazards:</b>						
9.1	Are there other significant fire hazards that are inadequately controlled?	No		.		
<b>Fire Protection Measures</b>						
<b>10 Means of Escape from Fire:</b>						
10.1	Is it considered that the building is provided with reasonable means of escape in case of fire?	Yes		.		
10.2	Escape routes unobstructed and safe to use?	Yes		.		
10.3	Exits easily and immediately openable where necessary, without a key?	Yes		.		
10.4	Reasonable distances of travel where there is a single/alternative direction of travel?	Yes		.		
10.5	Escape routes lead to final exits and open in direction of escape where necessary?	Yes		.		
10.6	Do failsafe's on locked exit doors function correctly?	N/A		.		
10.7	Is it considered that the building is provided with reasonable arrangements for means of escape for disabled people?	Yes		.		
<b>11 Measures to Limit Fire Spread and Development:</b>						
11.1	Is it considered that the compartmentation is of a reasonable standard?	Yes		.		
11.2	Is there reasonable limitation of surface finishes that might promote fire spread (walls, floors, ceilings)?	Yes		.		
11.3	Are fire dampers/shutters provided in ducts/refuse chutes to protect means of escape against fire, smoke and combustion products?	N/A		.		

11.4	Compartmentation within roof spaces of a satisfactory standard?	N/A	No Access to roof space from Common Area	.		
11.5	Loft hatches fire resisting?	N/A		.		
11.6	Fire stopping above cross-corridor fire doors within suspended ceiling void of a satisfactory standard	N/A	No Cross Corridor Doors at tis scheme	.		
11.7	Smoke Control Systems (AOV's) Are records of annual testing available?	N/A	No Automatic vents fitted at this scheme	.		
11.8	Roller shutter doors (fire resisting)	N/A		.		
11.9	Do the external walls, windows, balconies etc pose a risk of significant fire spread?	No		.		
<b>12</b>	<b>Communal Area Fire Doors (Inspection to include - construction, hinges, closure devices, intumescent/smoke seal condition, glazing systems and maximum gaps between door and frame.</b>					
12.1	Communal fire doors to FD30s standard and in a serviceable condition,	Yes	The communal fire door is at the side of the stairs and is locked shut	.		
12.2	"Fire door keep shut/locked" signage displayed on both sides of all applicable doors.	Yes		.		
12.3	Hold open devices operate at the sounding of the alarm and are in a serviceable condition	N/A	No Hold open devices at this scheme	.		
<b>13</b>	<b>Flat entrance doors (Internal Common Areas)</b>					
13.1	Do flat entrance doors open onto internal escape routes?	Yes	If yes, see "Residents Front Doors Sheet"	.		
<b>14</b>	<b>Flats with a single direction of escape to a single escape stairway. (External Balcony)</b>					
14.1	Do the flat entrance doors that open onto an external balcony have to be passed during an escape?	N/A	If yes, see "Residents Front Doors Sheet"	.		
14.2	Are the separating walls between the flats and the balcony floor that have to be passed during an escape, fire-resisting up to a height of 1.1m?	N/A		.		
<b>15</b>	<b>Emergency Escape Lighting:</b>					

15.1	Is the emergency lighting correctly specified and installed as per BS 5266-1:2016	Yes		.		
15.2	Are all emergency lighting units in good condition and securely fixed to walls/ceilings	Yes		.		
15.9	Are records of monthly testing available?	Yes	Monthly test certs uploaded to X Drive In date at time of inspection	.		
15.10	Are records of annual testing available?	Yes	Annual test certs uploaded to X Drive In date at time of inspection	.		
<b>16</b>	<b>Fire Safety Signs and Notices:</b>					
16.1	Are the correct Fire Action/Advice notices displayed in prominent locations within the common areas?	Yes		.		
16.3	Directional fire escape signage in place and adequate?	Yes		.		
16.4	Is there a suitable LIFT sign i.e. do not use in case of fire.	N/A		.		
<b>17</b>	<b>Means of giving Warning in case of Fire:</b>					
17.1	Is the fire detection and warning system appropriate for the occupancy and fire risk?	Yes		.		
17.2	Is the fire detection and warning system correctly specified and installed as per BS 5839-1:2017	Yes		.		
17.3	Is the fire detection and warning system maintained/tested and all certificates saved on file. (BS 5839-1:2017)	Yes		.		
17.4	Are there heat detectors located in the Kitchen, Boiler, Plant Room and Laundry?	Yes		.		
17.5	Is the fire alarm panel remotely monitored, and if so are there records of regular testing?	N/A	No Fire alarm Panel at this scheme	.		



17.6	Are smoke/heat detectors within General Needs flats subject to an annual inspection and the results recorded on an in date Landlord Gas Safety Record (LGSR)	Yes	If solid fuel burning appliances are fitted within flats	.		
<b>18</b>	<b>Fire Extinguishing Equipment:</b>					
18.1	Portable fire extinguishers - appropriate type/number/position?	N/A		.		
18.2	Correct signage displayed by each fire extinguisher?	N/A		.		
18.3	Fire blanket in communal kitchen, secured to the wall, complete with signage?	N/A		.		
18.4	Hose Reels - fitted, maintained?	N/A		.		
18.5	Dry/wet risers - Full access to all inlet/outlet boxes. All inlet/outlets secured and/or securing straps fitted to outlet valves?	N/A		.		
18.6	Records available of fire fighting equipment servicing within past 12 months	N/A		.		
<b>19</b>	<b>Management of Fire Safety</b>					
19.1	Are there suitable arrangements for summoning the fire service?	Yes	Residents responsible for callin fire service	.		
19.2	Do relevant staff carry out regular fire safety checks	Yes		.		
19.3	Sheltered Schemes & Regional Offices - Are there sufficient number of qualified Fire wardens.	N/A		.		
19.4	Offices - Are there suitable arrangements for ensuring the premises are evacuated?	N/A		.		
19.5	Offices - Are there suitable arrangements for evacuating disabled people?	N/A		.		

19.6	Offices - Are there suitable arrangements for meeting the fire service on arrival and providing relevant information?	N/A		.		
19.7	Offices/IL Schemes - Is there a suitable assembly point?	N/A		.		
19.8	Offices - Are fire drills carried out at appropriate intervals?	N/A		.		
<b>20</b>	<b>Evacuation Policy</b>					
20.1	Taking the findings of the FRA into account, is the evacuation policy appropriate for the scheme?	Yes		.		
<b>21</b>	<b>Miscellaneous</b>					

Residents Front Doors						
7 Oak Mount					08/02/2024	
Flat entrance doors to FD30s specification (Inspection to include - Door condition, construction, closure devices, intumescent/smoke seal condition, glazing systems, fire rated letterplate, door furniture and maximum gaps between door and frame/threshold.						
Flat No.	Access Gained	Asset No.	Observation/Comments / Actions Required	Risk Rating	Completion Date	Referred To:
2	No		The flat door and fixtures and fittings appeared to be in good condition at the time of inspection.	-		
3	No		The flat door and fixtures and fittings appeared to be in good condition at the time of inspection.	-		
4	No		The flat door and fixtures and fittings appeared to be in good condition at the time of inspection.	-		
5	No		The flat door and fixtures and fittings appeared to be in good condition at the time of inspection.	-		

Photographs - Fire

08/02/2024

7 Oak Mount



Photo No. 1

External Fire escape



Photo No. 2

External Bin Storage

Photographs - Fire

08/02/2024

7 Oak Mount



Photo No. 3

None Maintained Emergency Lighting

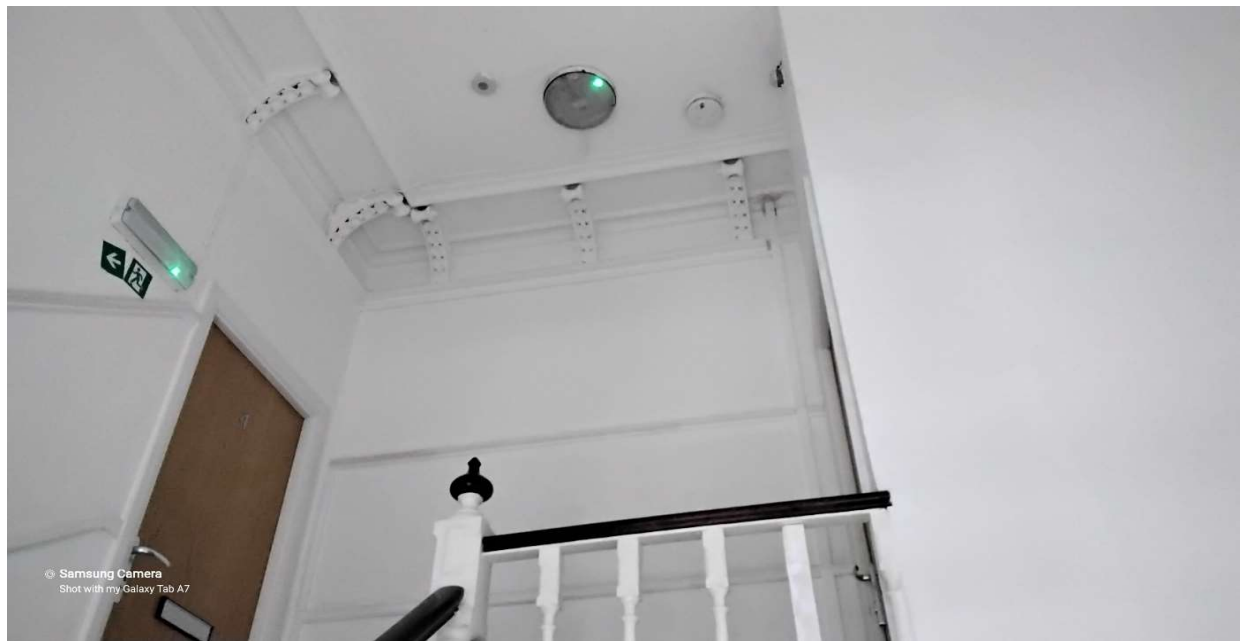


Photo No. 4

Smoke detection

## 6. Risk Calculator - Fire

The following risk estimator is based on the general health and safety risk level estimator contained within BS 8800: 1996. Guide to occupational health and safety management systems.

1. Taking into account the fire prevention measures observed at the time of this risk assessment, it is considered that the hazard from the fire (the probability of ignition) at this building is:

(please insert x below)

LOW       MEDIUM       HIGH

2. Taking into account the nature of the building, the occupants, the fire protection afforded and any procedural arrangements observed at the time of the assessment, it is considered that the consequences for life safety in the event of a fire would be:

(please insert x below)

MINOR       MAJOR       CRITICAL

The definition of the above terms is as follows:

***FKA REVIEW Frequency***

<b>MINOR</b>	Outbreak of fire is unlikely to result in serious injury or death of any occupant (other than the occupant sleeping in a bedroom in which a fire occurs).
<b>MAJOR</b>	An outbreak of fire could result in injury of one or more occupants, but is unlikely to lead to fatalities.
<b>CRITICAL</b>	There is significant potential for serious injury or death of one or more occupants.

3. The above estimates are then read into the following matrix table to give the overall risk level for the site:

Fire Hazard	Minor	Major	Critical
Low	Trivial	Tolerable	Moderate
Medium	Tolerable	Moderate	Substantial
High	Moderate	Substantial	Intolerable

When the level of risk is established, the action level can be read from the table below:

Risk Level	Guide to actions and appropriate timescales
Trivial	No action is required
Moderate	Efforts should be made to reduce the risk level and this should be carried out within the specified time periods.
Substantial	Considerable resources may have to be allocated to reduce the risk level. It may be necessary to limit the occupation of some parts until urgent remedial action is
Intolerable	The building (or the relevant area) should not be occupied until the risk is reduced.